

# SUBMITTAL DATA

The new IRIS DAMPER uses interlocking steel plates and a calibrated control system to form an adjustable aperture. By measuring differential pressure across the pressure ports, and referring to the matching performance curves, airflow can be precisely determined. Ten sizes are available, from 4" through 32", with capacities from 15 CFM to 20,000 CFM.  
 Tel: 1-800-779-4021 Fax: 1-800-779-4022


# IRIS-S DAMPER

by:



203 Eggert Road  
 Buffalo, New York  
 14215  
 T. 716-842-0670 F. 716-842-0611

12-205 Matheson Blvd. East  
 Mississauga, Ontario  
 L4W 3E3  
 T. 905-890-6192 F. 905-890-6193

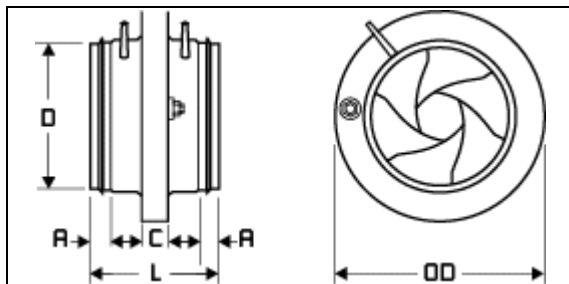

## IRIS-S DIMENSIONAL DATA

	4"	5"	6"	8"	10"	12"	16"	20"	25"	32"
A	1.2	1.2	1.0	1.2	1.6	1.8	2.4	2.0	2.0	3.9
C	0.6	0.6	0.6	0.6	0.7	0.7	0.8	0.8	0.9	0.9
L	4.4	4.5	4.7	4.7	5.3	6.1	7.5	6.7	6.7	10.6
D	3.9	4.9	5.9	7.8	9.8	11.8	15.7	19.6	24.7	31.4
OD	6.5	7.4	9.1	11.2	13.2	16.1	20.7	25.8	32.1	40.0

### HOW TO USE THE IRIS DAMPER

The Iris-S Damper has the capability of accurately measuring airflow to within 5%.  
 Once the damper position has been set:


- 1) Measure static pressure in inches W.G. using BOTH black measuring tubes.
- 2) Refer to the adjustment curve for the corresponding size of the damper.
- 3) Find your measured pressure on the scale on the left side of the adjustment curve. Proceed horizontally across the curve until you meet the damper position line corresponding to your damper position.
- 4) Drop vertically down and read CFM from the bottom scale.
- 5) To increase CFM, open the damper.  
 To decrease CFM, close the damper.  
 Measure new static pressure and proceed through steps 2 through 4.

### CONSTRUCTION MATERIAL

IRIS-S DAMPERS are constructed in acid-proof (AISI 316/316L) material and fitted with a neoprene gasket for airtight mounting.

### MOUNTING

When installed in a straight duct run, Iris-S Dampers provide airflow measurement accuracy of 5% ( $L = 10xD$ ). Duct fittings disturb the airflow and affect accuracy. Use the illustrations below to determine minimum spacing for the desired accuracy.

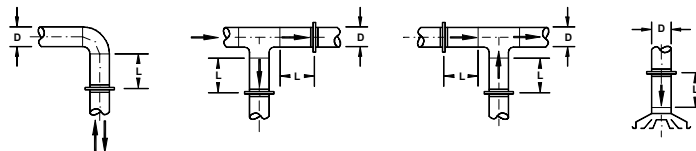

Accuracy 7%	$L = 1D$	$L = 4D$	$L = 2D$	$L = 2D$
Accuracy 10%	$L = 1D$	$L = 2D$	$L = 2D$	$L = 2D$

PROJECT			ARCHITECT		
CONTRACTOR	DATE	SUBMITTED	ENGINEER		

## SPECIFICATION

ITEM NO.	Qty	Additional Information/Optional Equipment